



# MANCHESTER-BY-THE-SEA

## BOARD OF HEALTH

TOWN HALL - 10 CENTRAL STREET

Manchester-by-the-Sea, Massachusetts 01944-1399

Telephone (978) 526-7385

FAX (978) 526-2009

July 24, 2023

Ellen Canty, Trustee  
Canty Family 1996 Trust  
855 Main Street  
Fremont, NH 03044

### NOTIFICATION TO OWNER ACTION REQUIRED

Upon receipt of the Title 5 Inspection Report for the onsite sewage disposal system at:

Property Address: **22 HICKORY HILL ROAD, MANCHESTER-BY-THE-SEA**

Property Owner: CANTY FAMILY 1996 TRUST

Licensed Title 5 Inspector: Benjamin Prescott, D.F. Clark, Inc. SI# 13851

The Title 5 Inspection Report dated: 6/28/2023

#### **Further action is required:**

- The on-site septic system for this property was not designed to accommodate garbage grinders per 310 CMR 15.223(1)(c). **You are required to provide a licensed plumber's receipt to confirm the removal of the garbage grinder(s).**
- Section D.11. states "the bottom of the SAS is 62' below grade". Please clarify if you intended to note feet or inches.

Note: The septic tank was not pumped as part of the inspection.

Section D.6. states "Heavy root infiltration was observed."

Reviewing Board of Health Agent:

Wendy Hansbury RS, Public Health Director

THIS INSPECTION reflects the present condition of the sanitary disposal system and is not any guarantee as to the life or future condition of said system. A passing Title 5 Inspection Report with pump receipts for three years within each calendar year may be used for sale of property. (Explanation: If there is a potential that your home will be sold within three years, you MUST have the septic tank pumped once a year, within a year of the date of the approved Title 5 Inspection Report for each of the three years. This allows the sale to occur with the use of the pumping reports and annual receipts abates the need for a "Title 5 System Inspection" for a property transfer within three years of the passing inspection, otherwise a passing Title 5 Inspection Report is only good for two years.)



D.F. CLARK, INC.



July 20, 2023

The Canty Family 1996 Trust  
c/o Ellen Canty, Trustee  
855 Main Street  
Fremont, NH 03044

RE: 22 Hickory Hill Road, Manchester, MA

Dear Ellen:

Please find enclosed the Subsurface Sewage Disposal System Inspection Report for the above-referenced property. As noted on Part B (Certification) of the report, the system Passes the inspection criteria. This inspection is good for the next two (2) years; you may extend the life of the inspection to three (3) years by having the septic tank pumped annually (before anniversary date of inspection).

Thank you for allowing us to be of service to you on this project. Please contact us if you have any questions regarding this matter.

Sincerely,  
D.F. Clark, Inc.

Benjamin "Jamie" Prescott  
Title 5 Inspector

Enclosure

cc: ✓ Manchester Board of Health w/ review fee  
D.F. Clark, Inc. file





Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

MA

01944

June 28, 2023

City/Town

State

Zip Code

Date of Inspection

**Inspection results must be submitted on this form. Inspection forms may not be altered in any way. Please see completeness checklist at the end of the form.**

**Important:** When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



## A. Inspector Information

Benjamin "Jamie" Prescott

Name of Inspector

D.F. Clark, Inc.

Company Name

22 Mitchell Road, PO Box 265

Company Address

Ipswich

MA

01938

City/Town

State

Zip Code

(978) 356-5638

SI13851

Telephone Number

License Number

## B. Certification

I certify that: I am a DEP approved system inspector in full compliance with Section 15.340 of Title 5 (310 CMR 15.000); I have personally inspected the sewage disposal system at the property address listed above; the information reported below is true, accurate and complete as of the time of my inspection; and the inspection was performed based on my training and experience in the proper function and maintenance of on-site sewage disposal systems. After conducting this inspection I have determined that the system:

1. ☒ Passes
2. ☐ Conditionally Passes
3. ☐ Needs Further Evaluation by the Local Approving Authority
4. ☐ Fails

*Benjamin Prescott*

Inspector's Signature

June 28, 2023

Date

The system inspector shall submit a copy of this inspection report to the Approving Authority (Board of Health or DEP) within 30 days of completing this inspection. If the system has a design flow of 10,000 gpd or greater, the inspector and the system owner shall submit the report to the appropriate regional office of the DEP. The original form should be sent to the system owner and copies sent to the buyer, if applicable, and the approving authority.

**Please note: This report only describes conditions at the time of inspection and under the conditions of use at that time. This inspection does not address how the system will perform in the future under the same or different conditions of use.**



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## C. Inspection Summary

Inspection Summary: Complete 1, 2, 3, or 5 and all of 4 and 6.

### 1) System Passes:

- ☒ I have not found any information which indicates that any of the failure criteria described in 310 CMR 15.303 or in 310 CMR 15.304 exist. Any failure criteria not evaluated are indicated below.

Comments:

The system meets all the criteria for a passing Title 5 Inspection as described in 310 CMR 15.300.

### 2) System Conditionally Passes:

- ☐ One or more system components as described in the "Conditional Pass" section need to be replaced or repaired. The system, upon completion of the replacement or repair, as approved by the Board of Health, will pass.

Check the box for "yes", "no" or "not determined" (Y, N, ND) for the following statements. If "not determined," please explain.

The septic tank is metal and over 20 years old\* or the septic tank (whether metal or not) is structurally unsound, exhibits substantial infiltration or exfiltration or tank failure is imminent. System will pass inspection if the existing tank is replaced with a complying septic tank as approved by the Board of Health.

\* A metal septic tank will pass inspection if it is structurally sound, not leaking and if a Certificate of Compliance indicating that the tank is less than 20 years old is available.

☐ Y      ☐ N      ☐ ND (Explain below):



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## C. Inspection Summary (cont.)

### 2) System Conditionally Passes (cont.):

☐ Pump Chamber pumps/alarms not operational. System will pass with Board of Health approval if pumps/alarms are repaired.

☐ Observation of sewage backup or break out or high static water level in the distribution box due to broken or obstructed pipe(s) or due to a broken, settled or uneven distribution box. System will pass inspection if (with approval of Board of Health):

☐ broken pipe(s) are replaced ☐ Y ☐ N ☐ ND (Explain below):

☐ obstruction is removed ☐ Y ☐ N ☐ ND (Explain below):

☐ distribution box is leveled or replaced ☐ Y ☐ N ☐ ND (Explain below):

☐ The system required pumping more than 4 times a year due to broken or obstructed pipe(s). The system will pass inspection if (with approval of the Board of Health):

☐ broken pipe(s) are replaced ☐ Y ☐ N ☐ ND (Explain below):

☐ obstruction is removed ☐ Y ☐ N ☐ ND (Explain below):

### 3) Further Evaluation is Required by the Board of Health:

☐ Conditions exist which require further evaluation by the Board of Health in order to determine if the system is failing to protect public health, safety or the environment.

**a. System will pass unless Board of Health determines in accordance with 310 CMR 15.303(1)(b) that the system is not functioning in a manner which will protect public health, safety and the environment:**



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

MA

01944

June 28, 2023

City/Town

State

Zip Code

Date of Inspection

Owner  
information is  
required for every  
page.

## C. Inspection Summary (cont.)

- ☐ Cesspool or privy is within 50 feet of a surface water
- ☐ Cesspool or privy is within 50 feet of a bordering vegetated wetland or a salt marsh

**b. System will fail unless the Board of Health (and Public Water Supplier, if any) determines that the system is functioning in a manner that protects the public health, safety and environment:**

- ☐ The system has a septic tank and soil absorption system (SAS) and the SAS is within 100 feet of a surface water supply or tributary to a surface water supply.
- ☐ The system has a septic tank and SAS and the SAS is within a Zone 1 of a public water supply.
- ☐ The system has a septic tank and SAS and the SAS is within 50 feet of a private water supply well.
- ☐ The system has a septic tank and SAS and the SAS is less than 100 feet but 50 feet or more from a private water supply well\*\*.

Method used to determine distance: \_\_\_\_\_

\*\* This system passes if the well water analysis, performed at a DEP certified laboratory, for fecal coliform bacteria indicates absent and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis must be attached to this form.

c. Other:

---

---

---

---

## 4) System Failure Criteria Applicable to All Systems:

You must indicate "Yes" or "No" to each of the following for all inspections:

Yes No

☐ ☒

Backup of sewage into facility or system component due to overloaded or clogged SAS or cesspool

☐ ☒

Discharge or ponding of effluent to the surface of the ground or surface waters due to an overloaded or clogged SAS or cesspool



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

Owner  
information is  
required for every  
page.

## C. Inspection Summary (cont.)

### 4) System Failure Criteria Applicable to All Systems: (cont.)

Yes	No	
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Static liquid level in the distribution box above outlet invert due to an overloaded or clogged SAS or cesspool
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Liquid depth in cesspool is less than 6" below invert or available volume is less than ½ day flow
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Required pumping more than 4 times in the last year <b>NOT</b> due to clogged or obstructed pipe(s). Number of times pumped: _____.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Any portion of the SAS, cesspool or privy is below high ground water elevation.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Any portion of cesspool or privy is within 100 feet of a surface water supply or tributary to a surface water supply.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Any portion of a cesspool or privy is within a Zone 1 of a public water supply well.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Any portion of a cesspool or privy is within 50 feet of a private water supply well.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	Any portion of a cesspool or privy is less than 100 feet but greater than 50 feet from a private water supply well with no acceptable water quality analysis. <b>[This system passes if the well water analysis, performed at a DEP certified laboratory, for fecal coliform bacteria indicates absent and the presence of ammonia nitrogen and nitrate nitrogen is equal to or less than 5 ppm, provided that no other failure criteria are triggered. A copy of the analysis and chain of custody must be attached to this form.]</b>
<input type="checkbox"/>	<input checked="" type="checkbox"/>	The system is a cesspool serving a facility with a design flow of 2000 gpd-10,000 gpd.
<input type="checkbox"/>	<input checked="" type="checkbox"/>	<b>The system fails.</b> I have determined that one or more of the above failure criteria exist as described in 310 CMR 15.303, therefore the system fails. The system owner should contact the Board of Health to determine what will be necessary to correct the failure.

### 5) Large Systems: To be considered a large system the system must serve a facility with a design flow of 10,000 gpd to 15,000 gpd.

For large systems, you must indicate either "yes" or "no" to each of the following, in addition to the questions in Section C.4.

Yes	No	
<input type="checkbox"/>	<input type="checkbox"/>	the system is within 400 feet of a surface drinking water supply
<input type="checkbox"/>	<input type="checkbox"/>	the system is within 200 feet of a tributary to a surface drinking water supply
<input type="checkbox"/>	<input type="checkbox"/>	the system is located in a nitrogen sensitive area (Interim Wellhead Protection Area – IWPA) or a mapped Zone II of a public water supply well



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

Owner  
information is  
required for every  
page.

## C. Inspection Summary (cont.)

If you have answered "yes" to any question in Section C.5 the system is considered a significant threat, or answered "yes" to any question in Section C.4 above the large system has failed. The owner or operator of any large system considered a significant threat under Section C.5 or failed under Section C.4 shall upgrade the system in accordance with 310 CMR 15.304. The system owner should contact the appropriate regional office of the Department.

### 6. You must indicate "yes" or "no" for each of the following for *all* inspections:

Yes      No

- |                                     |                                     |                                                                                                                                                                                                                                                                      |
|-------------------------------------|-------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Pumping information was provided by the owner, occupant, or Board of Health                                                                                                                                                                                          |
| <input type="checkbox"/>            | <input checked="" type="checkbox"/> | Were any of the system components pumped out in the previous two weeks?                                                                                                                                                                                              |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Has the system received normal flows in the previous two week period?                                                                                                                                                                                                |
| <input type="checkbox"/>            | <input checked="" type="checkbox"/> | Have large volumes of water been introduced to the system recently or as part of this inspection?                                                                                                                                                                    |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Were as built plans of the system obtained and examined? (If they were not available note as N/A)                                                                                                                                                                    |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Was the facility or dwelling inspected for signs of sewage back up?                                                                                                                                                                                                  |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Was the site inspected for signs of break out?                                                                                                                                                                                                                       |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Were all system components, excluding the SAS, located on site?                                                                                                                                                                                                      |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Were the septic tank manholes uncovered, opened, and the interior of the tank inspected for the condition of the baffles or tees, material of construction, dimensions, depth of liquid, depth of sludge and depth of scum?                                          |
| <input type="checkbox"/>            | <input checked="" type="checkbox"/> | Was the facility owner (and occupants if different from owner) provided with information on the proper maintenance of subsurface sewage disposal systems? The <b>size and location of the Soil Absorption System (SAS)</b> on the site has been determined based on: |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Existing information. For example, a plan at the Board of Health.                                                                                                                                                                                                    |
| <input checked="" type="checkbox"/> | <input type="checkbox"/>            | Determined in the field (if any of the failure criteria related to Part C is at issue approximation of distance is unacceptable) [310 CMR 15.302(5)]                                                                                                                 |





Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information

### 1. Residential Flow Conditions:

Number of bedrooms (design): N/A Number of bedrooms (actual): Four (4)

DESIGN flow based on 310 CMR 15.203 (for example: 110 gpd x # of bedrooms): N/A

Description:

No design plan available.

Number of current residents: Two (2)

Does residence have a garbage grinder? ☒ Yes ☐ No

Does residence have a water treatment unit? ☐ Yes ☒ No

If yes, discharges to: \_\_\_\_\_

Is laundry on a separate sewage system? (Include laundry system inspection information in this report.) ☒ Yes ☐ No

Laundry system inspected? ☒ Yes ☐ No

Seasonal use? ☐ Yes ☒ No

Water meter readings, if available (last 2 years usage (gpd)): 27 gpd

Detail:

April 2, 2021 - April 5, 2023 = 20,100 gallons divided by 733 days = 27 gallons per day

Sump pump? ☐ Yes ☒ No

Last date of occupancy: Currently occupied



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information (cont.)

### 2. Commercial/Industrial Flow Conditions:

Type of Establishment:

Design flow (based on 310 CMR 15.203):

Gallons per day (gpd)

Basis of design flow (seats/persons/sq.ft., etc.):

Grease trap present?

☐ Yes ☐ No

Water treatment unit present?

☐ Yes ☐ No

If yes, discharges to:

Industrial waste holding tank present?

☐ Yes ☐ No

Non-sanitary waste discharged to the Title 5 system?

☐ Yes ☐ No

Water meter readings, if available:

Last date of occupancy/use:

Date

Other (describe below):

### 3. Pumping Records:

Source of information:

Last pumped on November 23, 2022 per Board of  
Health file

Was system pumped as part of the inspection?

☐ Yes ☒ No

If yes, volume pumped:

gallons

How was quantity pumped determined?

Reason for pumping:



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

MA

01944

June 28, 2023

City/Town

State

Zip Code

Date of Inspection

## D. System Information (cont.)

### 4. Type of System:

- ☐ Septic tank, distribution box, soil absorption system
- ☐ Single cesspool
- ☐ Overflow cesspool
- ☐ Privy
- ☐ Shared system (yes or no) (if yes, attach previous inspection records, if any)
- ☐ Innovative/Alternative technology. Attach a copy of the current operation and maintenance contract (to be obtained from system owner) and a copy of latest inspection of the I/A system by system operator under contract
- ☐ Tight tank. Attach a copy of the DEP approval.
- ☒ Other (describe):  
Septic tank, three (3) leaching pits

Approximate age of all components, date installed (if known) and source of information:

As-built is dated April 1, 1982 per Board of Health file.

Were sewage odors detected when arriving at the site?

☐ Yes ☒ No

### 5. Building Sewer (locate on site plan):

Depth below grade:

2.08  
feet

Material of construction:

☒ cast iron

☐ 40 PVC

☐ other (explain):

Distance from private water supply well or suction line:

N/A  
feet

Comments (on condition of joints, venting, evidence of leakage, etc.):

The building sewer pipe is in good condition with no signs of leakage.



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information (cont.)

### 6. Septic Tank (locate on site plan):

Depth below grade:

1.33

feet

Material of construction:

☒ concrete

☐ metal

☐ fiberglass

☐ polyethylene

☐ other (explain)

If tank is metal, list age:

years

Is age confirmed by a Certificate of Compliance? (attach a copy of certificate)

☐ Yes

☐ No

Dimensions:

8' L x 5' W x 4' D (effective depth)

Sludge depth:

6"

Distance from top of sludge to bottom of outlet tee or baffle

25"

Scum thickness

0"

Distance from top of scum to top of outlet tee or baffle

N/A

Distance from bottom of scum to bottom of outlet tee or baffle

N/A

How were dimensions determined?

Tape measure & Sludge Judge

Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

The 1,000-gallon septic tank is 16" below grade. There is a concrete inlet baffle in place and a PVC

outlet tee. There is no filter present. The tank is structurally sound with no signs of leakage or

infiltration. The liquid level is normal and equals the outlet invert. Heavy root infiltration was observed.

Pumping is not needed at this time.



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road - Laundry System

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information (cont.)

### 4. Type of System:

- ☐ Septic tank, distribution box, soil absorption system
- ☐ Single cesspool
- ☐ Overflow cesspool
- ☐ Privy
- ☐ Shared system (yes or no) (if yes, attach previous inspection records, if any)
- ☐ Innovative/Alternative technology. Attach a copy of the current operation and maintenance contract (to be obtained from system owner) and a copy of latest inspection of the I/A system by system operator under contract
- ☐ Tight tank. Attach a copy of the DEP approval.
- ☒ Other (describe):  
Laundry-only leaching pit

Approximate age of all components, date installed (if known) and source of information:

As-built is dated April 1, 1982 per Board of Health file.

Were sewage odors detected when arriving at the site?

☐ Yes ☒ No

### 5. Building Sewer (locate on site plan):

Depth below grade:

2.08  
feet

Material of construction:

☒ cast iron

☐ 40 PVC

☐ other (explain):

Distance from private water supply well or suction line:

feet

Comments (on condition of joints, venting, evidence of leakage, etc.):

The building sewer pipe is in good condition with no signs of leakage.



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road - Laundry System

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information (cont.)

### 6. Laundry Leaching Pit (locate on site plan):

Depth below grade:

6"

feet

Material of construction:

☒ concrete

☐ metal

☐ fiberglass

☐ polyethylene

☐ other (explain)

If tank is metal, list age:

years

Is age confirmed by a Certificate of Compliance? (attach a copy of certificate)

☐ Yes

☐ No

Dimensions:

500 gallon leaching pit

Sludge depth:

0"

Distance from top of sludge to bottom of outlet tee or baffle

N/A

Scum thickness

0"

Distance from top of scum to top of outlet tee or baffle

N/A

Distance from bottom of scum to bottom of outlet tee or baffle

N/A

How were dimensions determined?

Tape measure & Sludge Judge

Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

The pit has an effective depth of 2' and is 6" below grade. This pit is used for the laundry system only.

There is no sign of hydraulic failure and the bottom is above the ESHGW.



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information (cont.)

### 7. Grease Trap (locate on site plan):

Depth below grade:

feet

Material of construction:

☐ concrete

☐ metal

☐ fiberglass

☐ polyethylene

☐ other (explain):

Dimensions:

Scum thickness

Distance from top of scum to top of outlet tee or baffle

Distance from bottom of scum to bottom of outlet tee or baffle

Date of last pumping:

Date

Comments (on pumping recommendations, inlet and outlet tee or baffle condition, structural integrity, liquid levels as related to outlet invert, evidence of leakage, etc.):

### 8. Tight or Holding Tank (tank must be pumped at time of inspection) (locate on site plan):

Depth below grade:

Material of construction:

☐ concrete

☐ metal

☐ fiberglass

☐ polyethylene

☐ other (explain):

Dimensions:

Capacity:

gallons

Design Flow:

gallons per day



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information (cont.)

### 8. Tight or Holding Tank (cont.)

Alarm present:

☐ Yes ☐ No

Alarm level: \_\_\_\_\_

Alarm in working order: ☐ Yes ☐ No

Date of last pumping:

\_\_\_\_\_  
Date

Comments (condition of alarm and float switches, etc.):

---

---

---

---

\* Attach copy of current pumping contract (required). Is copy attached?

☐ Yes ☐ No

### 9. Distribution Box (if present must be opened) (locate on site plan):

Depth of liquid level above outlet invert \_\_\_\_\_

Comments (note if box is level and distribution to outlets equal, any evidence of solids carryover, any evidence of leakage into or out of box, etc.):

---

---

---

---

---





Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information (cont.)

### 10. Pump Chamber (locate on site plan):

Pumps in working order:

☐ Yes ☐ No\*

Alarms in working order:

☐ Yes ☐ No\*

Comments (note condition of pump chamber, condition of pumps and appurtenances, etc.):

---

---

---

---

\* If pumps or alarms are not in working order, system is a conditional pass.

### 11. Soil Absorption System (SAS) (locate on site plan, excavation not required):

If SAS not located, explain why:

---

---

---

Type:



leaching pits

number:

Three (3)



leaching chambers

number:



leaching galleries

number:



leaching trenches

number, length:



leaching fields

number, dimensions:



overflow cesspool

number:



innovative/alternative system

Type/name of technology:

---



Owner  
information is  
required for every  
page.

## Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information (cont.)

### 11. Soil Absorption System (SAS) (cont.)

Comments (note condition of soil, signs of hydraulic failure, level of ponding, damp soil, condition of vegetation, etc.):

The soil absorption system (SAS) consists of three (3) 500-gallon leaching pits. The pits are 27"

below grade with risers & concrete covers to 12" below grade. The covers measure 20.5" x 20.5".

None of them show ponding or signs of hydraulic failure. The pits sit 15' from the road & are 7.5' apart

with an effective depth of 2' each. Evidence of solids carryover & 6" of water was observed in Pit 1.

Pit 2 had roots but was dry, & Pit 3 had dry stones at the bottom. Bottom of SAS is 62' below grade.

### 12. Cesspools (cesspool must be pumped as part of inspection) (locate on site plan):

Number and configuration

Depth – top of liquid to inlet invert

Depth of solids layer

Depth of scum layer

Dimensions of cesspool

Materials of construction

Indication of groundwater inflow

☐ Yes ☐ No

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

Owner  
information is  
required for every  
page.

## D. System Information (cont.)

13. **Privy** (locate on site plan):

Materials of construction:

Dimensions

Depth of solids

Comments (note condition of soil, signs of hydraulic failure, level of ponding, condition of vegetation, etc.):



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

MA

01944

June 28, 2023

City/Town

State

Zip Code

Date of Inspection


Owner  
information is  
required for every  
page.

## D. System Information (cont.)

### 14. Sketch Of Sewage Disposal System:

Provide a view of the sewage disposal system, including ties to at least two permanent reference landmarks or benchmarks. Locate all wells within 100 feet. Locate where public water supply enters the building. Check one of the boxes below:

- ☒ hand-sketch in the area below  
☐ drawing attached separately

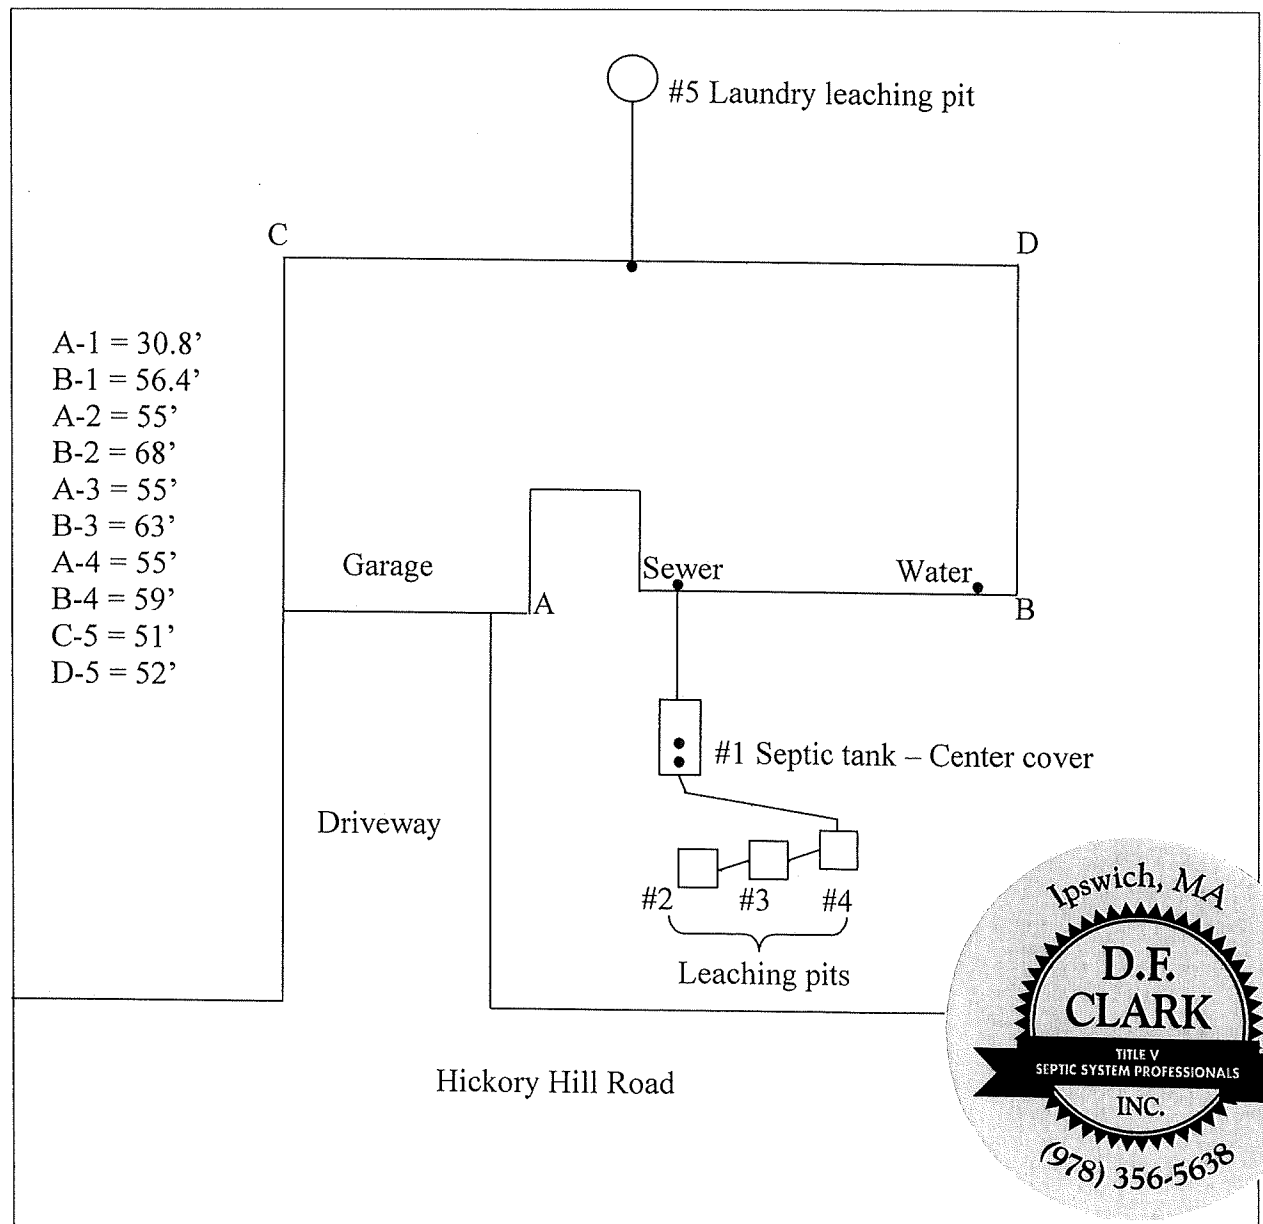



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

Owner  
information is  
required for every  
page.

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

City/Town

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

## D. System Information (cont.)

### 15. Site Exam:

- ☒ Check Slope – SAS sits below the rest of the property.
- ☒ Surface water – None observed.
- ☒ Check cellar – Dry with no sump pump.
- ☒ Shallow wells – None located.

Estimated depth to high ground water:

6.67  
feet

Please indicate all methods used to determine the high ground water elevation:

- ☐ Obtained from system design plans on record  
If checked, date of design plan reviewed: \_\_\_\_\_  
Date
- ☐ Observed site (abutting property/observation hole within 150 feet of SAS)
- ☒ Checked with local Board of Health - explain:  
Soil testing at 20 Hickory Hill Road
- ☐ Checked with local excavators, installers - (attach documentation)
- ☐ Accessed USGS database - explain:  
\_\_\_\_\_

You **must** describe how you established the high ground water elevation:

John Judd, witnessed by Gerald McDonald of the Board of Health, performed soil testing on April 27 & July 16, 2022 at 20 Hickory Hill Road, with ESHGW determined to be @ 80". On April 27, T-1 was dug & observed to a depth of 84" with ESHGW @ 80". On July 16 T-2 was dug & observed to a depth of 74" before pit was flooded with sewage from the failed system. Based on this soil testing and the measurements from this inspection, there is no interfacing between the SAS and ESHGW. If soil testing is done at this site the results of this report may change.

**Before filing this Inspection Report, please see Report Completeness Checklist on next page.**



Commonwealth of Massachusetts

# Title 5 Official Inspection Form

Subsurface Sewage Disposal System Form - Not for Voluntary Assessments

22 Hickory Hill Road

Property Address

The Canty Family 1996 Trust

Owner's Name

Manchester-by-the-Sea

MA

State

01944

Zip Code

June 28, 2023

Date of Inspection

Owner  
information is  
required for every  
page.

## E. Report Completeness Checklist

Complete all applicable sections of this form inclusive of:

☒ A. Inspector Information: Complete all fields in this section.

☒ B. Certification: Signed & Dated and 1, 2, 3, or 4 checked

☒ C. Inspection Summary:

1, 2, 3, or 5 completed as appropriate

4 (Failure Criteria) and 6 (Checklist) completed

☒ D. System Information:

For 8: Tight/Holding Tank – Pumping contract attached

For 14: Sketch of Sewage Disposal System drawn on pg. 16 or attached

For 15: Explanation of estimated depth to high groundwater included

**Customer Transaction Summary****Customer Information**

Account No: 801626  
CANTY FAMILY 1996 TR  
22 HICKORY HILL ROAD  
MANCHESTER, MA 01944

**Location Information**

Location No: 0911900  
22 HICKORY HILL ROAD  
MANCHESTER, MA 01944

Date	Type	More Info	Reading		Usage	Prior Balance	Transaction Amount	Balance
05/16/2018	Charge	04/10/2018	2658	1	1800	0.00	103.70	103.70
05/23/2018	Payment	CCC				103.70	-103.70	0.00
08/15/2018	Charge	07/03/2018	2682	1	2400	0.00	141.74	141.74
09/04/2018	Payment	CCC				141.74	-141.74	0.00
11/15/2018	Charge	10/02/2018	2708	1	2600	0.00	160.23	160.23
11/20/2018	Payment	CHECK				160.23	-160.23	0.00
02/15/2019	Charge	01/08/2019	2730	1	2200	0.00	133.91	133.91
03/11/2019	Payment	CCC				133.91	-133.91	0.00
05/15/2019	Charge	04/10/2019	2748	1	1800	0.00	107.59	107.59
05/28/2019	Payment	CCC				107.59	-107.59	0.00
08/15/2019	Charge	07/12/2019	2771	1	2300	0.00	145.81	145.81
08/28/2019	Payment	CHECK				145.81	-145.81	0.00
11/15/2019	Charge	10/09/2019	2797	1	2600	0.00	166.30	166.30
12/20/2019	Payment	CCC				166.30	-166.30	0.00
02/15/2020	Charge	01/08/2020	2819	1	2200	0.00	138.98	138.98
03/02/2020	Payment	CCC				138.98	-138.98	0.00
05/15/2020	Charge	04/06/2020	2836	1	1700	0.00	104.83	104.83
06/04/2020	Payment	CCC				104.83	-104.83	0.00
08/17/2020	Charge	07/15/2020	2861	1	2500	0.00	159.47	159.47
09/03/2020	Payment	CCC				159.47	-159.47	0.00
11/16/2020	Charge	10/06/2020	2885	1	2400	0.00	155.27	155.27
11/24/2020	Payment	CCC				155.27	-155.27	0.00
02/16/2021	Charge	01/07/2021	2907	1	2200	0.00	141.37	141.37
03/18/2021	Payment	CCC				141.37	-141.37	0.00
05/17/2021	Charge	04/02/2021	2927	1	2000	0.00	127.47	127.47
06/15/2021	Payment	CCC				127.47	-127.47	0.00
08/16/2021	Charge	07/07/2021	2953	1	2600	0.00	169.17	169.17
09/03/2021	Payment	CCC				169.17	-169.17	0.00
11/15/2021	Charge	10/05/2021	2978	1	2500	0.00	165.88	165.88
11/29/2021	Payment	CCC				165.88	-165.88	0.00
02/15/2022	Charge	01/04/2022	3001	1	2300	0.00	151.66	151.66
03/17/2022	Payment	CCC				151.66	-151.66	0.00
05/16/2022	Charge	04/05/2022	3024	1	2300	0.00	151.66	151.66
05/24/2022	Payment	CCC				151.66	-151.66	0.00
08/15/2022	Charge	07/14/2022	3054	1	3000	0.00	201.43	201.43
08/26/2022	Payment	CCC				201.43	-201.43	0.00
11/15/2022	Charge	10/06/2022	3084	1	3000	0.00	207.39	207.39
12/14/2022	Payment	CCC				207.39	-207.39	0.00
02/15/2023	Charge	01/05/2023	3116	1	3200	0.00	222.03	222.03
03/06/2023	Payment	CCC				222.03	-222.03	0.00
05/15/2023	Charge	04/05/2023	3128	1	1200	0.00	78.93	78.93
05/18/2023	Payment	UNIBANK				78.93	-78.93	0.00